

NOTES:

ALL WORKS REGARDING THE FOUL SEWER TO BE CARRIED OUT TO IRISH WATER CODE OF PRACTICE DOCUMENT CDS-5030-03

INDIVIDUAL WASTEWATER CONNECTION TO EACH DWELLING WILL BE AS PER STANDARD DETAIL STD-WW-02

REFER TO SECTION 3.2 FOR SERVICE CONNECTION GRADIENTS.

THE INSPECTION CHAMBER WILL BE IN COMPLIANCE WITH STD-WW-03 AND STD-WW-13 AND WILL BE LOCATED WITHIN 1M OF EACH SITE BOUNDARY.

PIPE MATERIALS SHALL COMPLY WITH SECTION 3.13. OF THE IRISH WATER CODE OF PRACTICE.

PIPE MATERIALS WILL BE UNPLASTICISED PVC FOR THE MAIN SEWERS AS PER SECTION 3.13.3 OF THE IRISH WATER CODE OF PRACTICE.

MANHOLES WILL CONFORM TO STANDARD DETAILS STD-WW-09, STD-WW-10, STD-WW-11 AND/OR STD-WW-12 AS APPROPRIATE.

SEPARATION DISTANCES FROM FOUL SEWERS TO STRUCTURES AND OTHER UTILITIES WILL COMPLY WITH SECTION 3.5 OF THE IRISH WATER CODE OF PRACTICE.

REFER TO STD-W-12A, STD-WW-06, STD-WW-06A & 3.26 OF THE IRISH WATER CODE OF PRACTICE FOR PLANTING RESTRICTIONS OF WATER AND WASTE WATER. ROOT PROTECTION TO BE REROOT 2000 OR SIMILAR.

REFER TO DETAIL STD-W-11 FOR TYPICAL SERVICES LAYOUT DISTANCES & STD-WW-05 FOR WASTEWATER TYPICAL SERVICES LAYOUT AND 3.21 IRISH WATER WASTEWATER CODE OF PRACTICE.

REFER TO SECTION 3.5.16 OF THE WASTE WATER IRISH WATER CODE OF PRACTICE FOR UNAVOIDABLE SERVICES CROSSOVER.

MANHOLE COVERS LOCATED IN GRASS AREAS TO HAVE 200mm ALL ROUND CONCRETE PLINTH AND 100mm DEEP FORMED CONCRETE, 20mm AGGREGATE, BEDDED IN CLAUSE 804 MATERIAL.

REFER TO 3.5.13 OF THE IRISH WATER CODE OF PRACTICE FOR STAGGERED MANHOLE SYSTEMS DETAILS.

EXTERNAL FACE OF PROPOSED MANHOLE CHAMBER TO BE A MINIMUM OF 0.5m FROM KERB LINE AND EXTERNAL FACE OF SEWERS ARE A MINIMUM OF 1m FROM KERB LINE. SEE SECTION 3.5.15 OF IRISH WATER WASTEWATER CODE OF PRACTICE

ALL WORKS TO COMPLY WITH THE RECOMMENDATIONS FOR SITE DEVELOPMENT WORKS FOR HOUSING AREAS AS ISSUED BY THE DEPARTMENT OF THE ENVIRONMENT NOVEMBER 1998

ALSO REFER TO ALAN TRAYNOR CONSULTING ENGINEERS GENERAL SPECIFICATION

ALL SEWER PIPES WITH LESS THAN 1200MM COVER IN ROADS AND 600MM ELSEWHERE TO BE SURROUNDED IN MINIMUM 150MM THICK CONCRETE (55N/20)

THIS DRAWING TO BE READ IN CONJUNCTION WITH ARCHITECTS DRAWINGS

EXACT START & FINISHED LEVELS TO BE CONFIRMED ON SITE

ALL MANHOLE COVERS TO BE LOADING CLASS D400 AND TO BE LOCKABLE

LOCATION AND LEVELS OF ALL EXISTING SERVICES TO BE CONFIRMED ON SITE AND RECORDED TO ALL NECESSARY PARTIES PRIOR TO ANY CONSTRUCTIONS

WATER INFRASTRUCTURE

CONFIRMATION BY A CHARTERED ENGINEER AND TEST RESULT CERTIFICATES & REPORTS INDICATING THAT THE WATER INFRASTRUCTURE HAS UNDERGONE APPROPRIATE ON-SITE TESTING, OFF SITE TESTING AND COMMISSIONING. THE APPROPRIATE SITE TESTS FOR WATER COLLECTION INFRASTRUCTURE WOULD BE AS FOLLOWS:

- IGN TEST REPORTS - WATERMAIN PRESSURE TESTING
- SERVICE CONNECTION TEST RESULTS
- ELECTROBUTT FUSION WELD TEST RESULT REPORTS (DESTRUCTIVE TESTING)
- PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH ELECTROFUSION & BUTT FUSION JOINT
- TESTING COMPLETION RESULTS FOR BOOSTER PUMP PLANT (IF APPROPRIATE)
- SWABBING & FLUSHING RECORDS
- DISINFECTION TEST REPORTS (ACCREDITED LABORATORY REPORT)
- WATER QUALITY SAMPLING RESULTS (ACCREDITED LABORATORY REPORT)

WASTE WATER INFRASTRUCTURE

CONFIRMATION BY A CHARTERED ENGINEER AND TEST RESULT CERTIFICATES INDICATING THAT THE WASTEWATER INFRASTRUCTURE HAS UNDERGONE APPROPRIATE ON-SITE TESTING AND COMMISSIONING. THE APPROPRIATE SITE TESTS FOR WASTEWATER COLLECTION INFRASTRUCTURE WOULD BE AS FOLLOWS:

- AIR TESTS AND WATER TESTS COMPLETION RESULTS FOR SEWERS
- WATER RETAINING TESTS COMPLETION RESULTS FOR MANHOLES AND PUMPING STATION STRUCTURES
- PRESSURE TESTING COMPLETION RESULTS OF RISING MAINS COMPLETE WITH A HARD COPY PRINTOUT FROM THE LOGGER OF THE RELAXATION CURVE AS PROOF OF THE OUTCOME OF THE TEST (IGN 4-01-03 COMPLIANT REPORT)
- A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT (HDPE WELDING)
- PUMPING STATIONS - TESTING & COMMISSIONING REPORTS

WASTEWATER INFRASTRUCTURE - CCTV & MANHOLE SURVEY REPORTS

REPORTING AND DELIVERING - THE FINAL REPORTS AND DELIVERABLES TO IRISH WATER SHALL INCLUDE THE FOLLOWING ITEMS:

A- CCTV SURVEY FOOTAGE: FILES IN "XML" FORMAT SUBMITTED TO IRISH IN ACCORDANCE WITH MSCC, 5TH ADDITION, COMPATIBLE WITH INFONET.


B - CCTV REPORTS: REPORTS SUBMITTED IDENTIFYING THAT NO DEFECTS EXIST. REPORTS SUBMITTED IN CD OR DVD FORMAT WITH A HARD COPY OF THE SURVEY REPORT.

C - MANHOLE SURVEY REPORTS: REPORTS SUBMITTED IDENTIFYING THAT NO DEFECTS EXIST. REPORTS SUBMITTED IN "CSC" FORMAT ON CD OR DVD WITH A HARD COPY OF THE SURVEY REPORTS. MANHOLE REFERENCING SHALL BE CONSISTENT WITH THE AS CONSTRUCTED DRAWINGS - TO IRISH NATIONAL GRID (COORDINATES (ING)) TO +/- 100mm ACCURACY IN THE HORIZONTAL PLANE, WITH DIMENSIONS RELATING TO FIXED ORDNANCE SURVEY CO-ORDINATES.

D - CERTIFICATION FROM THE CUSTOMERS CONSULTANT ENGINEER: CONFIRMATION THAT A QUALITY CONTROL REGIME HAS BEEN IMPLEMENTED WITH THE RESULT THAT NO DEFECTS EXIST IN EITHER THE SEWERS OR THE MANHOLES.

LEGEND

| | |
|------------------------------------|------------|
| PROPOSED 100mm STORM CONNECTION | --- |
| EXISTING STORM SEWER | --- |
| PROPOSED FOUL MANHOLE | ○ |
| PROPOSED FOUL SEWER | --- |
| PROPOSED FOUL INSPECTION CHAMBER | ⊙ |
| PROPOSED 100mm FOUL CONNECTION | --- |
| EXISTING FOUL MANHOLE | ○ |
| EXISTING FOUL SEWER | --- |
| PROPOSED WATERMAIN | --- |
| PROPOSED 25mm Ø SERVICE CONNECTION | --- |
| WATER BOUNDARY BOX | □ |
| SLUIKE VALVE | SV |
| HYDRANT | Hyd |
| AIR VALVE | AV |
| EXISTING WATERMAIN | --- |
| FINISHED FLOOR LEVELS | FFL 67.750 |
| SITE BOUNDARY | --- |

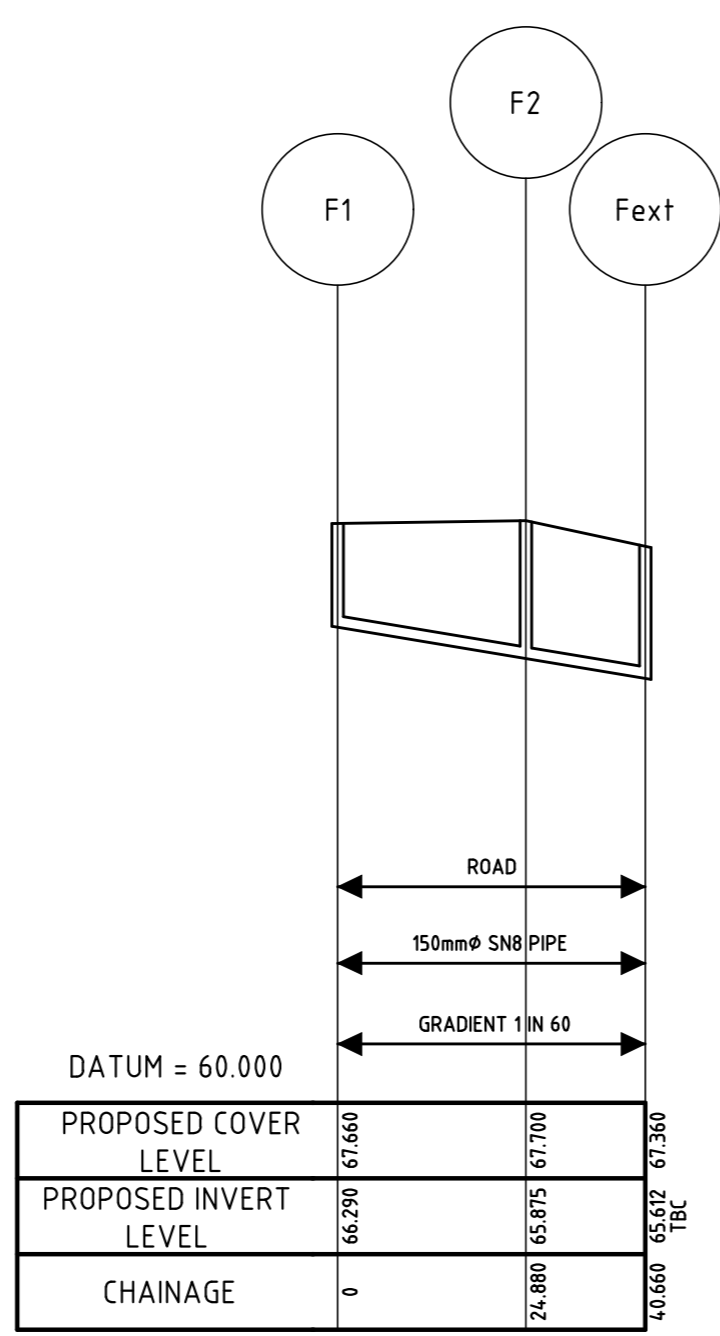

PROPOSED FOUL SEWER SECTIONS
F1-Fext
 HORIZONTAL SCALE 1:1000
 VERTICAL SCALE 1:100

Notes:

COPYRIGHT RESERVED - THIS DRAWING IS NOT TO BE USED FOR A PURPOSE OTHER THAN THAT FOR WHICH IT HAS BEEN ISSUED BY ALAN TRAYNOR CONSULTING ENGINEERS. NOR IS IT TO BE COPIED OR REPRODUCED IN ANY MATTER WITHOUT WRITTEN CONSENT.

ALAN TRAYNOR CONSULTING ENGINEERS LTD.

| REV. | DATE | DESCRIPTION | APPROVED | CLIENT |
|------|------|-------------|----------|--|
| | | | | Comhairle Chontae Leitrim Leitrim County Council |
| | | | | PROJECT TITLE PROPOSED RESIDENTIAL UNITS AT KESHCARRIGAN, CO. LEITRIM |
| | | | | DRAWING TITLE SITE SERVICES LAYOUT FOUL WATER SEWER, SURFACE WATER SEWER & WATERMAIN |
| | | | | SCALE 1:200 |
| | | | | DRAWN JOHN O'REILLY |
| | | | | CHECKED LIAM MCELGUNN |
| | | | | APPROVED ALAN TRAYNOR |
| | | | | DRAWING No. 23-039-100 |
| | | | | REV. |
| | | | | DATE SEPTEMBER 2023 |
| | | | | DATE SEPTEMBER 2023 |
| | | | | DATE SEPTEMBER 2023 |

Alan Traynor
 Consulting Engineers Ltd

Unit 6, Belthurbet Business Park, Creany, Belthurbet, Co. Cavan H14A9V4
 TEL: (+353) 49922224

2nd Floor, 67-70 Meath St. Dublin 8 D08BYS3
 TEL: (+353) 1497881

Email: info@alantaynor.com Website: www.alantaynor.com

ISO 9001 CERTIFICATION EUROPE
 ISO 14001 CERTIFICATION EUROPE
 ISO 45001 CERTIFICATION EUROPE

ENGINEERS IRELAND